

SERIES 4X CRYOGENIC

BRAY/McCANNALOK VALVES

Technical Manual

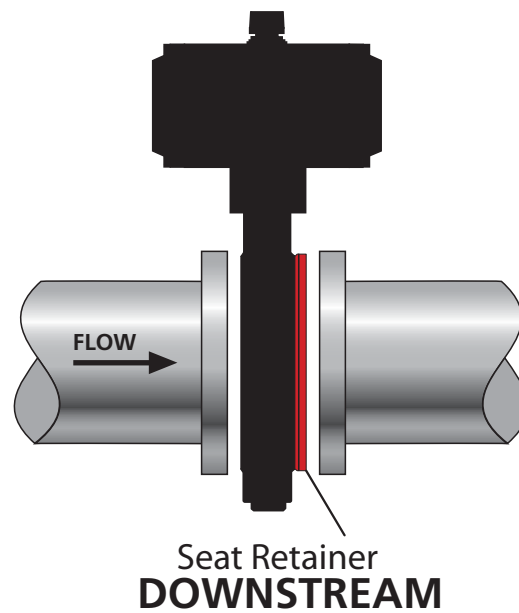


TABLE OF CONTENTS

Seating and Unseating Torques	1
ASME 150 - Torques (Lb-in)	2
ASME 300 - Torques (Lb-in)	2
Dynamic Torques	3
Dynamic Torque Coefficient	4
Subchoked and Choked Flow	5
Maximum Allowable Stem Torques (Lb-in)	6
Maximum Allowable Stem Torques (N-m)	6
Valve Sizing Coefficients (Cv)	7
ASME 150 Series 40/41 - Valve Sizing Coefficient (Cv)	7
ASME 300 Series 42/43 - Valve Sizing Coefficient (Cv)	7
Valve Sizing Coefficients (Kv)	8
ASME 150 Series 40/41 - Valve Sizing Coefficient (Kv)	8
ASME 300 Series 42/43 - Valve Sizing Coefficient (Kv)	8
Examples of Typical Flange to Valve Bolting	9



SEATING AND UNSEATING TORQUES



Check the flow direction of the media and ensure that the valve is installed with the retainer downstream.

Valve Size Inches	ASME Class 150 Operating Torque (in-lb)			
	Series 40/41 Cryogenic - Valve Differential Pressure (psig)			
	<150 psig	150-200 psig	200-250 psig	250-275 psig
3	945	993	1,040	1,073
4	1,194	1,267	1,340	1,391
6	1,850	2,033	2,217	2,345
8	3,622	3,980	4,337	4,588
10	5,410	6,088	6,767	7,242
12	7,927	9,003	10,079	10,833
14-24	CONSULT FACTORY			

Valve Size Inches	ASME Class 150 Operating Torque (Nm)			
	Series 40/41 Cryogenic - Valve Differential Pressure (bar)			
	<10.3 bar	10.3-14 bar	14-17.2 bar	17.2-19 bar
3	107	113	118	122
4	135	144	152	158
6	210	230	251	265
8	410	450	491	519
10	612	688	765	819
12	896	1,018	1,139	1,224
14-24	CONSULT FACTORY			

Valve Size Inches	ASME Class 300 Operating Torque (in-lb)			
	Series 42/43 Cryogenic - Valve Differential Pressure (psig)			
	<150 psig	150-350 psig	350-550 psig	550-720 psig
3	945	993	1,040	1,073
4	1,194	1,267	1,340	1,391
6	2,323	3,201	4,088	4,739
8	3,476	4,752	6,073	6,889
10	8,047	11,253	14,322	16,523
12	12,111	16,176	20,273	23,212
14-24	CONSULT FACTORY			


Valve Size Inches	ASME Class 300 Operating Torque (Nm)			
	Series 42/43 Cryogenic - Valve Differential Pressure (bar)			
	<10.3 bar	10.3-24 bar	24-38 bar	38-50 bar
3	107	113	118	122
4	135	144	152	158
6	263	362	462	536
8	393	537	687	779
10	910	1,272	1,619	1,867
12	1,369	1,828	2,291	2,623
14-24	CONSULT FACTORY			

DYNAMIC TORQUES

When a media flows through a butterfly valve, static pressure does not act uniformly on the surfaces of the valve disc. Dynamic torque will cause rotary motion when unchecked by the actuator or manual operator possibly resulting in opening or closing of the valve. If the dynamic torque is of a magnitude that is greater than the bearing and packing friction torque and there is no actuator in place to maintain disc position, the opening or closing action could result in injury to operating personnel or an interruption of the process. Sudden closure (slamming) can cause water hammer damage in lines carrying liquid.

In high performance butterfly valves which have the disc offset from the stem and have non-symmetrical disc faces, dynamic torque acts to close the valve if the valve is installed with the seat retainer downstream.

Seat Retainer Downstream

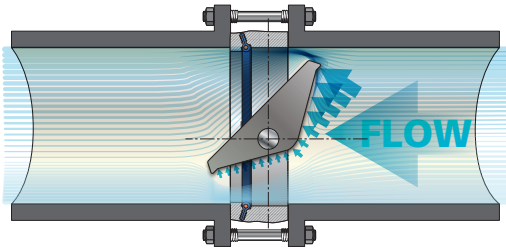

Dynamic torque should be calculated as part of the valve actuator sizing procedure or to determine if hand lever operation is acceptable. In this regard, the total torque of all service conditions must be considered.

The total torque when the disc is in the seat consists of:

1. Seating torque
2. Stem packing torque
3. Eccentricity torque
4. Stem bearing torque

The total torque when the disc is in the seat is published as seating/unseating torque. When the disc is out of the seat, the total torque consists of dynamic torque, stem packing torque, and stem bearing torque.

Total torque changes with the disc position. Maximum total torque can occur at shutoff (disc in the seat), at breakaway (motion initiation), or at any open disc position where the product of valve pressure drop and dynamic torque coefficient peaks in combination with prevailing bearing and packing torque.

Estimating Dynamic Torque

Dynamic torque can be estimated using the following empirical equations:

Liquid Flow:

$$\text{Imperial } T_d (\text{Lb-in}) = C_t D^3 \Delta p$$

$$\text{Metric } T_d (\text{N-m}) = .0001 C_t D^3 \Delta p$$

Gas Flow:

$$\text{Imperial } T_d (\text{Lb-in}) = C_t D^3 Y \Delta p$$

$$\text{Metric } T_d (\text{N-m}) = .0001 C_t D^3 Y \Delta p$$

Dynamic Torque - Terminology

C_t - dynamic torque coefficient (see graphs and tables on page 4 for values of C_t .) Positive value of C_t means that the dynamic torque acts to close the valve and a negative value of C_t to open the valve.

D - nominal valve size (in or mm)

F_k - ratio of specific heat factor (dimensionless)
 $F_k = k/1.40$ or $F_k = 1$ for air

k - ratio of specific heat (dimensionless)

Δp - effective pressure drop across the valve (psi or bar)

p_1 - valve inlet pressure (psia or bar abs.)

T_d - dynamic torque (Lb-in or N-m)

x - $x = \Delta p/p_1$

Y - gas expansion factor (dimensionless)
 $Y = 1 - x / (3 F_k x_t)$

x_t - gas critical pressure ratio (dimensionless) Values of x_t change with disc position and are identical for seat retainer upstream and downstream.

° Open	x_t	° Open	x_t
10°	0.46	55°	0.31
15°	0.46	60°	0.28
20°	0.46	65°	0.27
25°	0.45	70°	0.25
30°	0.44	75°	0.24
35°	0.42	80°	0.22
40°	0.39	85°	0.21
45°	0.35	90°	0.19
50°	0.33		

DYNAMIC TORQUE COEFFICIENT

Figure 1 - Seat Retainer Downstream


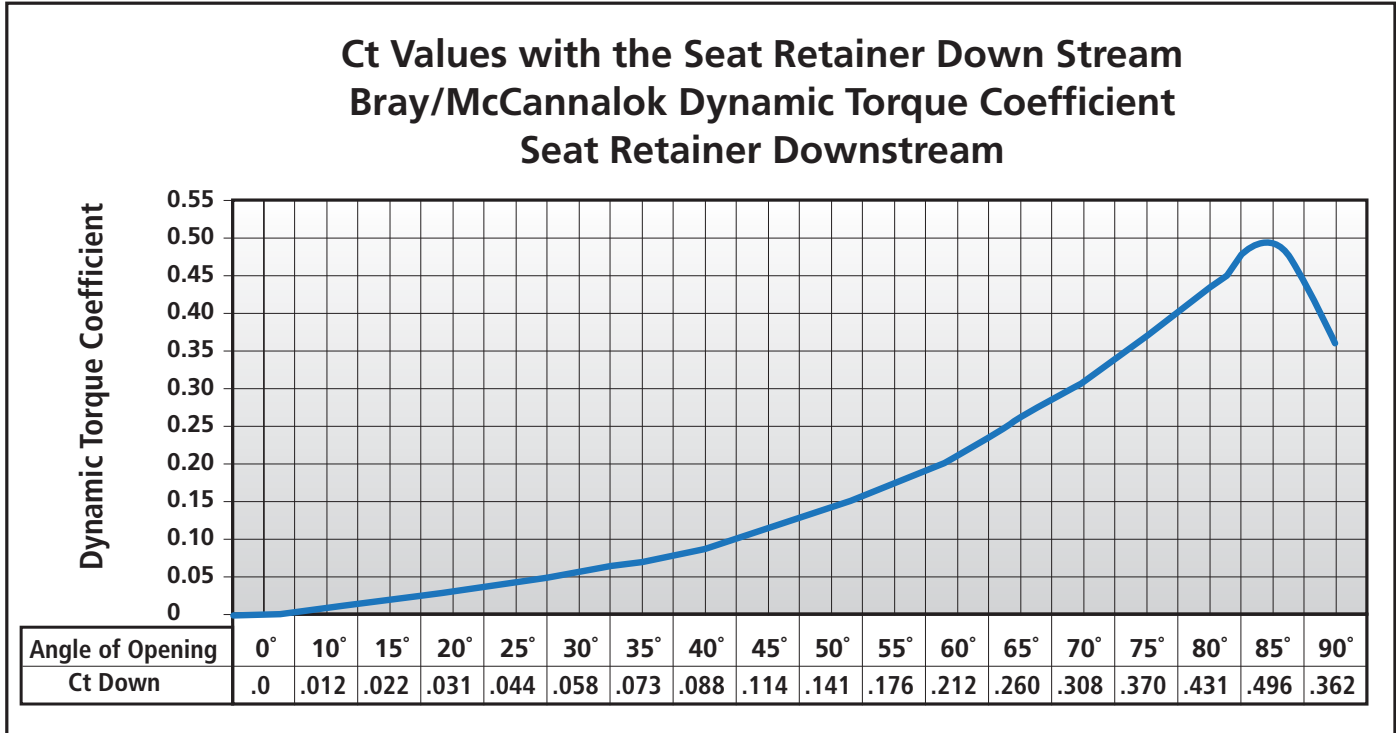


Figure 2 - Seat Retainer Upstream

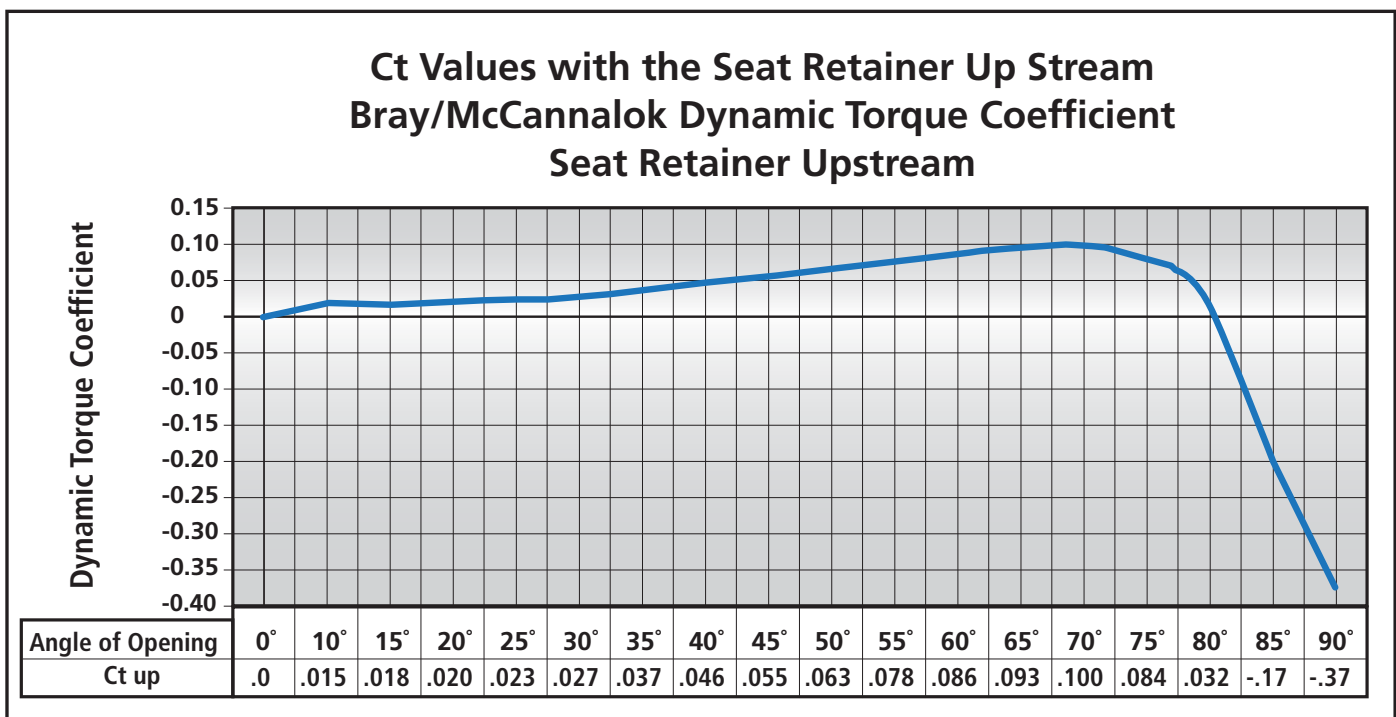

SUBCHOKED AND CHOKED FLOW

For	Condition	Use	Note
Subchoked Flow	Pipe and Valve Size Equal	<ul style="list-style-type: none"> Nominal Valve Size Valve Pressure Drop Ct from graphs/tables on "Figure 1 - Seat Retainer Downstream" on page 4 	
	With Pipe Reducers	<ul style="list-style-type: none"> Nominal Valve Size Ct from graphs/tables on "Figure 1 - Seat Retainer Downstream" on page 4 Valve Pressure Drop as if valve were installed in valve-sized pipe with same flow rate 	
Choked Flow	Pipe and Valve Size Equal	<ul style="list-style-type: none"> Nominal Valve Size Ct from graphs/tables on "Figure 1 - Seat Retainer Downstream" on page 4 Actual Pressure drop through valve. 	If actual pressure drop at the choked condition is not known, estimate by evaluating the pressure in the piping at the valve outlet needed to sustain the choked flow rate through the piping downstream of the valve; then subtracting it from the valve inlet pressure.
	With Pipe Reducers	<ul style="list-style-type: none"> Nominal Valve Size Ct from graphs/tables on "Figure 1 - Seat Retainer Downstream" on page 4 Actual pressure drop through valve/reducer assembly. 	If the pressure drop at the choked condition is not known, estimate the line pressure just downstream of the valve/reducer assembly which is needed to sustain the choked flow rate of the valve/reducer assembly through the downstream piping; then subtract this pressure from the line pressure just ahead of the valve/reducer assembly, to get the actual pressure drop.

For	Condition	Use	Note
Subchoked Flow	Pipe and Valve Size Equal	<ul style="list-style-type: none"> Nominal Valve Size Valve Pressure Drop Ct from graphs/tables on "Figure 1 - Seat Retainer Downstream" on page 4 	
	With Pipe Reducers	<ul style="list-style-type: none"> Nominal Valve Size Ct from graphs/tables on "Figure 1 - Seat Retainer Downstream" on page 4 Valve Pressure Drop (and expansion factor Y) as if valve were installed in valve-sized pipe with same flow rate. 	In calculating Y, use the line pressure just upstream of the inlet reducer for p1 and xt from the table on page 3.
Choked Flow	Pipe and Valve Size Equal	<ul style="list-style-type: none"> Nominal Valve Size Gas expansion factor Y of 2/3 Ct from graphs/tables on "Figure 1 - Seat Retainer Downstream" on page 4 $\Delta p = p1 Fk xt$ 	Use xt from the table on page 3.
	With Pipe Reducers	<ul style="list-style-type: none"> Nominal Valve Size Gas expansion factor Y of 2/3 Ct from graphs/tables on "Figure 1 - Seat Retainer Downstream" on page 4 $\Delta p = p1 Fk xt$ 	Use the line pressure just upstream of the inlet reducer for p1 and xt from the table above in calculating Δp , on page 3.

MAXIMUM ALLOWABLE STEM TORQUES (Lb-in)

Cryogenic and Low Temperature Valves

Valve Size inches	ASME 150	ASME 300
	Series S40/41	Series S42/43
3	1,968	1,968
4	1,968	1,968
6	3,368	5,630
8	5,544	10,292
10	10,251	18,511
12	14,454	27,818
14	Please Consult Factory	
16		
18		
20		
24		

Based on stem Material Code 54P and 5MF at ambient conditions (73°F)

MAXIMUM ALLOWABLE STEM TORQUES (N-m)

Cryogenic and Low Temperature Valves

Valve Size inches	ASME 150	ASME 300
	Series S40/41	Series S42/43
3	222	222
4	222	222
6	381	636
8	626	1,163
10	1,158	2,091
12	1,633	3,143
14	Please Consult Factory	
16		
18		
20		
24		

Based on shaft material code 54P and 5MF at ambient conditions (23°C)

VALVE SIZING COEFFICIENTS (Cv)

1. Cv stands for Valve Sizing Coefficient.
2. Cv varies with the valve size, angle of opening and the manufacturer's valve style.
3. Cv is defined as the volume of water in USGPM that will flow through a given restriction or valve opening with a pressure drop of one (1) psi at room temperature.

ASME 150 Series 40/41 - Valve Sizing Coefficient (Cv)									
Valve Size Inches	Disc Position (Degrees)								
	90°	80°	70°	60°	50°	40°	30°	20°	10°
3	185	178	155	123	87	56	32	14	5
4	375	365	315	250	175	115	63	31	10
6	1,350	1,070	750	510	330	218	140	81	35
8	2,800	2,230	1,590	1,060	685	456	280	165	65
10	4,300	3,450	2,430	1,630	1,050	700	450	250	100
12	6,650	5,330	3,750	2,530	1,630	1,080	700	390	155
14	Please Consult Factory								
16									
18									
20									
24									

ASME 300 Series 42/43 - Valve Sizing Coefficient (Cv)									
Valve Size Inches	Disc Position (Degrees)								
	90°	80°	70°	60°	50°	40°	30°	20°	10°
3	185	178	155	123	87	56	32	14	5
4	375	365	315	250	175	115	63	31	10
6	1,000	875	710	530	370	240	138	79	26
8	2,000	1,720	1,360	950	630	405	240	121	47
10	2,650	2,250	1,740	1,200	780	510	295	150	61
12	4,000	3,400	2,500	1,690	1,100	710	430	220	92
14	Please Consult Factory								
16									
18									
20									
24									

VALVE SIZING COEFFICIENTS (Kv)


1. Kv stands for Valve Sizing Coefficient.
2. Kv varies with the valve size, angle of opening and the manufacturer's valve style.
3. Kv is defined as the volume of water in Cubic Meters/Hour (m³/hr) that will flow through a given restriction or valve opening with a pressure drop of one (1) bar at room temperature.

ASME 150 Series 40/41 - Valve Sizing Coefficient (Kv)									
Valve Size mm	Disc Position (Degrees)								
	90°	80°	70°	60°	50°	40°	30°	20°	10°
80	158	152	132	105	74	48	27	12	4
100	320	311	269	213	149	98	54	26	9
150	1,152	913	640	435	281	186	119	69	30
200	2,388	1,902	1,356	904	584	389	239	141	55
250	3,668	2,943	2,073	1,390	896	597	384	213	85
300	5,672	4,546	3,199	2,158	1,390	921	597	333	132
350	Please Consult Factory								
400									
450									
500									
550									
600									




ASME 300 Series 42/43 - Valve Sizing Coefficient (Kv)									
Valve Size mm	Disc Position (Degrees)								
	90°	80°	70°	60°	50°	40°	30°	20°	10°
80	158	152	132	105	74	48	27	12	4
100	320	311	269	213	149	98	54	26	9
150	853	746	606	452	316	205	118	67	22
200	1,706	1,467	1,160	810	537	345	205	103	40
250	2,260	1,919	1,484	1,024	665	435	252	128	52
300	3,412	2,900	2,133	1,442	938	606	367	188	78
350	Please Consult Factory								
400									
450									
500									
550									
600									

Examples of Typical Flange to Valve Bolting*

Lug Style Bolting

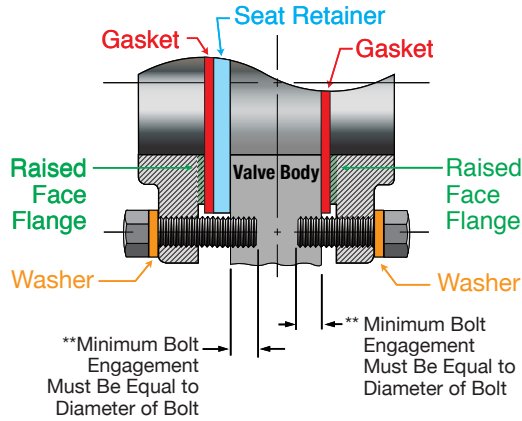

Wafer Style Bolting

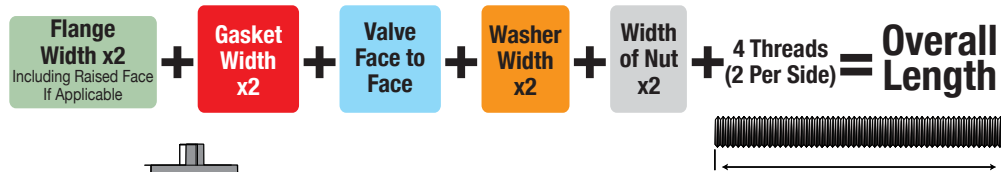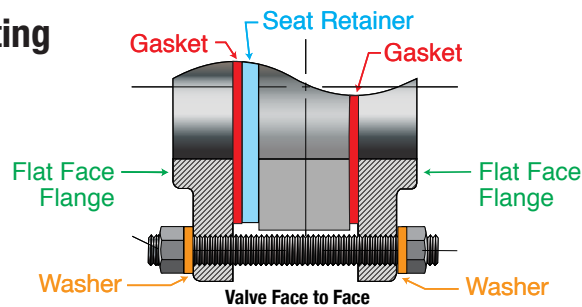

Note: Please refer to Appropriate Bray Dimensional Drawings for specific valve drilling information.

Applies to Wafer and Lug Valves as follows:
ASME Class 150 26" Valves and larger
ASME Class 300 14" Valves and larger
ASME Class 600 10" Valves and larger

Please refer to ASME B-16.5 or B-16.47 for Flange and Bolt Dimension Information

* Double flange style bolting not shown.

** Lug Threads may be tapped from both sides and therefore tap may not be continuous.



THE HIGH PERFORMANCE COMPANY



BRAY INTERNATIONAL PRIMARY SALES AND SERVICE LOCATIONS

USA Houston, Texas	CHINA Hangzhou, Zhejiang	MEXICO Zapopan, Jalisco	RUSSIA Moscow
AFRICA Johannesburg	COLOMBIA Bogotá	MIDDLE EAST Dubai	SINGAPORE Ubi Techpark
BENELUX Heerhugowaard	FRANCE Voiron	PACIFIC Melbourne, Australia	SOUTH KOREA Seoul
BRAZIL Paulinia, Sao Paulo	GERMANY Krefeld	PERU Lima	SOUTHEAST ASIA Malaysia
CANADA Montreal	INDIA Vadodara	POLAND Oświęcim	UNITED KINGDOM Glasgow
CHILE Santiago	ITALY Milano		

FLOW-TEK

USA Houston, Texas
BRAZIL Paulinia, Sao Paulo
CHINA Hangzhou, Zhejiang

RITE CORPORATION

CANADA Montreal

VALVTRONIC

ARGENTINA Buenos Aires

AMRESIST

USA Houston, Texas

BRAY/VAAS

INDIA Chennai

KUGELHAHN MÜLLER

GERMANY Krefeld

HEADQUARTERS

Bray International, Inc.
 13333 Westland East Blvd.
 Houston, Texas 77041
 Tel: 281.894.5454
 www.bray.com

All statements, technical information, and recommendations in this bulletin are for general use only. Consult Bray representatives or factory for the specific requirements and material selection for your intended application. The right to change or modify product design or product without prior notice is reserved. Patents issued and applied for worldwide.

Bray® is a registered trademark of Bray International, Inc.

© 2017 Bray International. All rights reserved.

TM_1059_Cryogenic_10_27_2017